

4

3


2

1

ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED

SCALE - N.T.S.

Minimum distance for efficient cooling
of motor (To be maintained by user)

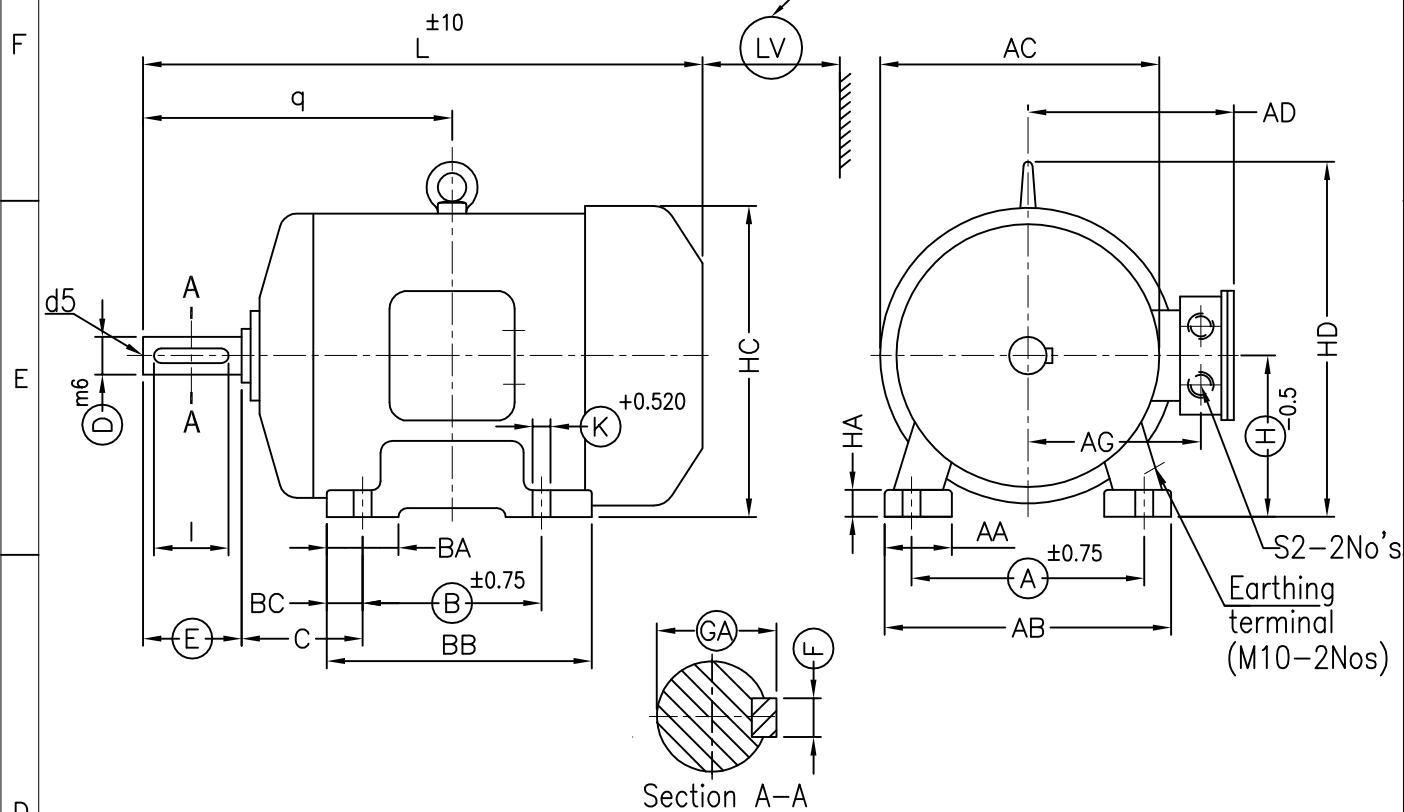

Fixing							General										
IEC Frame	Pole	A	B	C	H	K	AB	BB	AA	BA	BC	HA	HC	HD	AD	L	LV
200L	4,6	318	305	133	200	19	398	355	85	85	28	32	397	462	319	772	80

⑨

⑨

T Box				Shaft					
AC	q	AG	S2	D	E	F	GA	I	d5
394	396	249	2" B.S.C.	55	110	16	59	100	M20

Notes:-

- 1) Terminal box can be rotated in 360 deg in steps of 90 deg.
- 2) Ringed dimensions are as per IS:1231/IEC60072

⑨ Total Length Changed--NPJ--06.05.17

Customer		Project	
P.O. No.		Consultant	
kW/Pole		Client/Contractor	
Frame		Package	
SO No.		Tag no's	

A


A

	NAME	DATE
DRN	YCJ	07.04.2015
CHD		
APPD		

TITLE:

DIMENSION DRAWING

3PH SQUIRREL CAGE, TEFC (FOOT MOUNTED) INDUCTION MOTOR(SAFE AREA)



DRG. No:

A20L431RC ⑨

4

3

2

1